
NOTES:

1) 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE

2) ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE

3) THIS TANK DESIGNED FOR MAXIMUM BURIAL DEPTH OF 5 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL *****



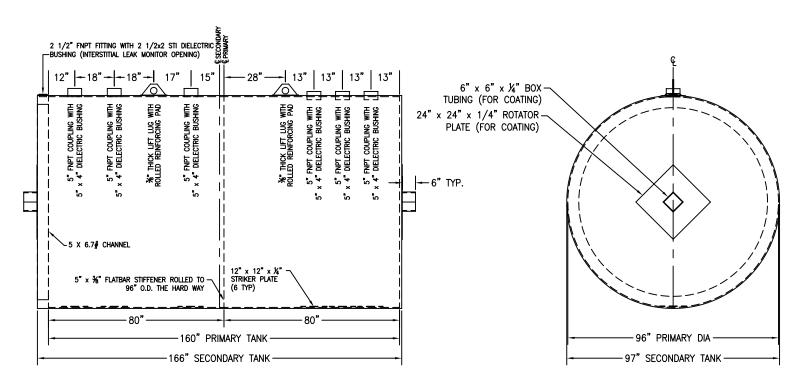

CUSTOMER APPROVAL SIGNATURE/DATE:	5,000 GALLON ACT-1000 D/W UNDER GROUND TANK		CUSTOMER:
·	SURFACE PREPARATION/COATING INFORMATION:	MATERIAL /CONSTRUCTION/ LABELING INFORMATION:	PROJECT: AGENT:
	INTERIOR SURFACES: N/A	MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)	
		MATERIAL THICKNESS: PRI TANK: 10 GA (ROARK MIN .123 W/STIFFNER) PRI HEADS: 1/4"	
	70 mils STEEL INSTITUTE APPROVED POLYURETHANE COATING	SECONDARY SHELL: 10 GA SECONDARY HEAD: 1/4"	NDUSTRIES
		CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR	BUILDING TANKS TO PEROTECT
		STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE ACT100—U SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF FRP	P.O. BOX 1279 GOLDSBORO, NC 27533
QUANTITY: ONE (1) REQUIRED		COMPOSITE STEEL LINDERGROUND STORAGE TANKS	PHONE: (919)751-1791 FAX: (919)751-8186 DRAWING NUMBER:
WEIGHT: 9,000 lbs ± 5%		LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58/ STI ACT100-U / G.I. NAMEPLATE	