
NOTES:

1) 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE

2) ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE

3) THIS TANK DESIGNED FOR MAXIMUM BURIAL DEPTH OF 5 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL *****



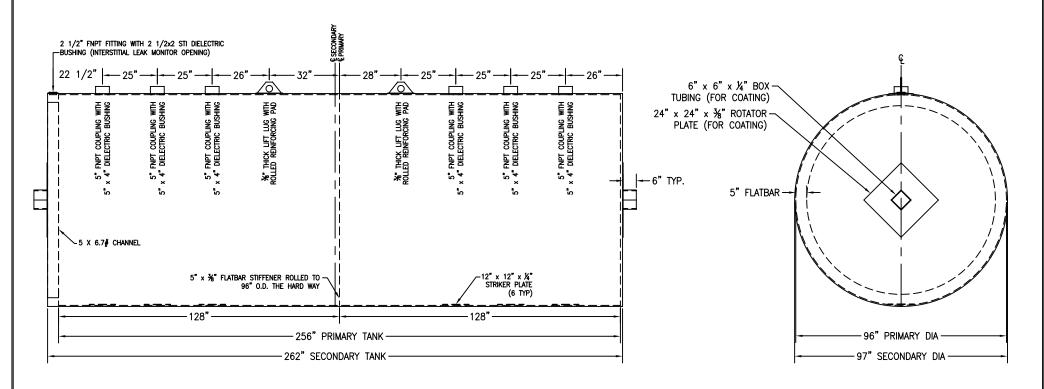

CUSTOMER APPROVAL SIGNATURE/DATE:	8.000 GALLON ACT-100U D/W UNDER GROUND TANK		CUSTOMER:	
DOSTOMEN ANT NOVAL SIGNATIONE, BATE	P		PROJECT:	
	SURFACE PREPARATION/COATING INFORMATION:	MATERIAL /CONSTRUCTION/ LABELING INFORMATION:	AGENT:	コ
	INTERIOR SURFACES: N/A	MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)		
	EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST CLEAN 70 mils STEEL INSTITUTE APPROVED POLYURETHANE COATING	MATERIAL THICKNESS: PRI TANK: 10 GA (ROARK MIN .123 w/STIFFNER) PRI HEADS: 1/4" SECONDARY SHELL: 10 GA SECONDARY HEAD: 1/4"	NDUSTRIES	
		CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL—58 STANDARD FOR STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK	BUILDING TANKS TO PEOTECT	
QUANTITY: ONE (1) REQUIRED		INSTITUTE ACT100-U SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF FRP	P.O. BOX 1279 GOLDSBORO, NC 27533 PHONE: (919)751-1791 FAX: (919)751-8186	
WEIGHT: 11,000 lbs ± 5%		LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58/ STI ACT100-U / G.I. NAMEPLATE	DRAWING NUMBER:	