


\*SADDLES ARE SEAL WELDED TO TANK

MORRISON 244OF 10"  
EMERGENCY VENT SHIPPED  
LOOSE DUE TO SHIPPING  
HEIGHT RESTRICTIONS

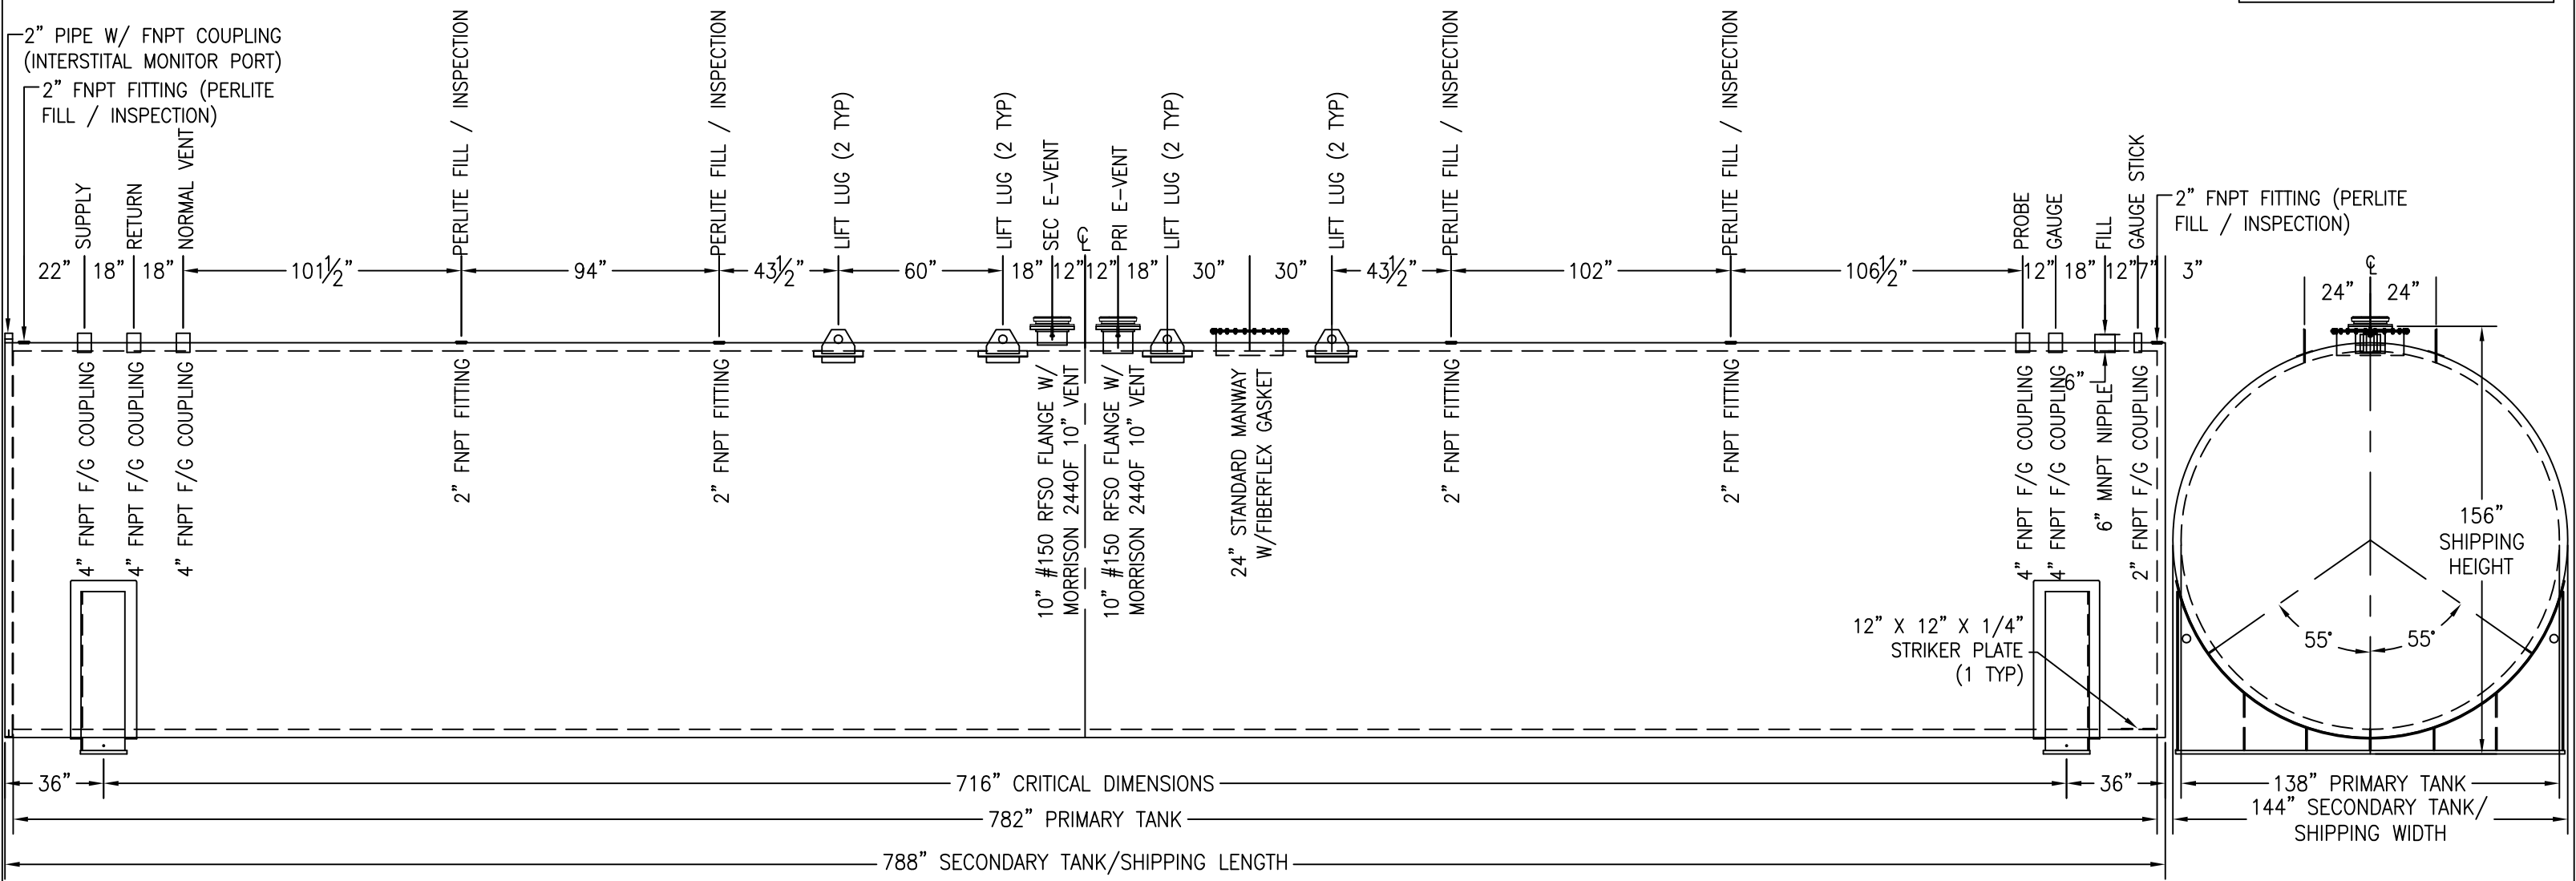

CUSTOMER APPROVAL SIGNATURE/DATE:

**50,000 GALLON THERMALLY INSULATED (FIREGUARD) STORAGE TANK**

**SURFACE PREPARATION/COATING INFORMATION:**  
 INTERIOR SURFACES: SSPC-SP-3 POWER TOOL CLEAN WELDS ONLY  
 REMOVE ALL LOOSE DEBRIS  
 EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST  
 ONE COAT WHITE URETHANE @ 5-7 MILS DFT

**MATERIAL /CONSTRUCTION/ LABELING INFORMATION:**  
 MATERIAL: CARBON STEEL ASTM A 36 OR A 569  
 MATERIAL THICKNESS: PRIMARY SHELL: 3/8" PRIMARY HEADS: 3/8"  
 SECONDARY SHELL: 3/8" SECONDARY HEADS: 3/8"

CUSTOMER:  
PROJECT:  
AGENT:




P.O. BOX 1279 GOLDSBORO, NC 27533  
 PHONE: (919)751-1791 FAX: (919)751-8186  
 DRAWING NUMBER: G1FG50K138

QUANTITY: ONE (1) REQUIRED  
 WEIGHT WITHOUT PERLITE: 85,500 lbs ± 10%  
 WEIGHT: 110,750 lbs ± 10%


LABELING/MARKING: UNDERWRITERS LABORATORIES UL-2085  
 / STEEL TANK INSTITUTE FIREGUARD

REVISED 6/15

\*SADDLES ARE SEAL WELDED TO TANK

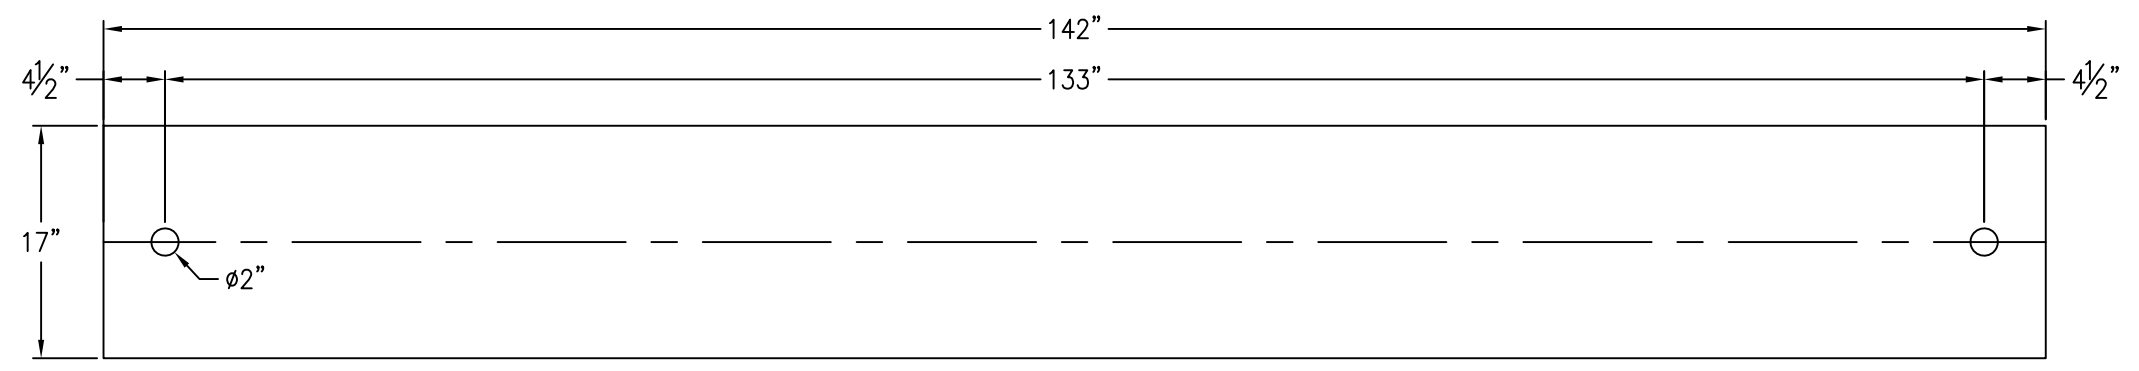

BASE PLATE ANCHOR HOLE DETAIL

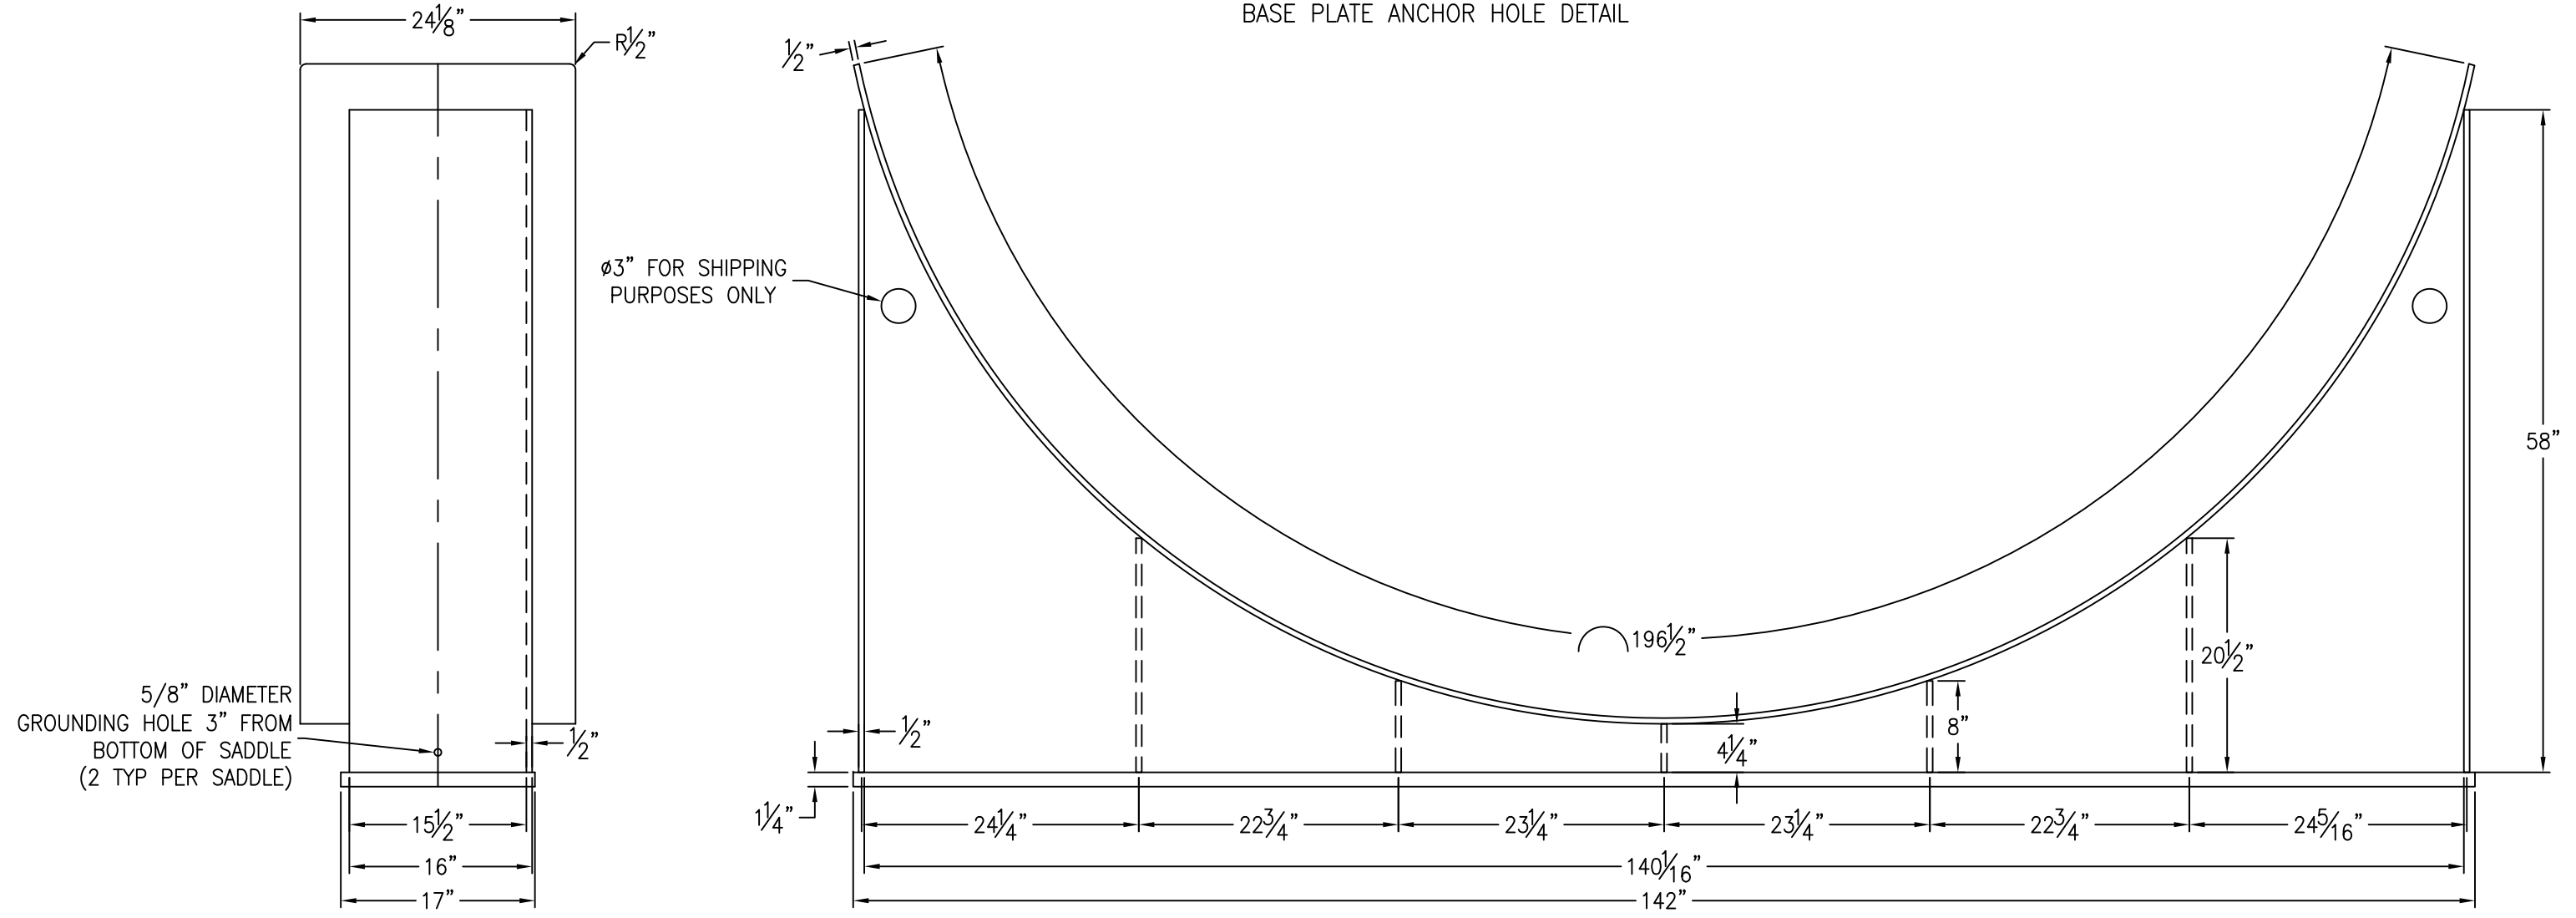

CUSTOMER APPROVAL SIGNATURE/DATE:

**50,000 GAL 6" TALL SADDLE FOR 144" DIAMETER FIREGUARD TANK**

**SURFACE PREPARATION/COATING INFORMATION:**

**MATERIAL /CONSTRUCTION/ LABELING INFORMATION:**

EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST  
ONE COAT WHITE URETHANE @ 5-7 MILS DFT

MATERIAL: CARBON STEEL ASTM A 36 OR A 569

CUSTOMER:  
PROJECT:  
AGENT:



P.O. BOX 1279 GOLDSBORO, NC 27533  
PHONE: (919)751-1791 FAX: (919)751-8186

DRAWING NUMBER: GI-FGS6F14450  
REVISED 6/15

QUANTITY: TWO (2) REQUIRED  
WEIGHT: 2,557 lbs ea ± 10%