
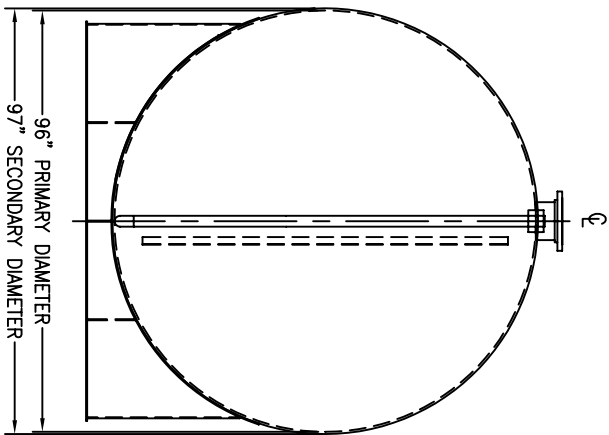


*SADDLES ARE SEAL WELDED TO TANK

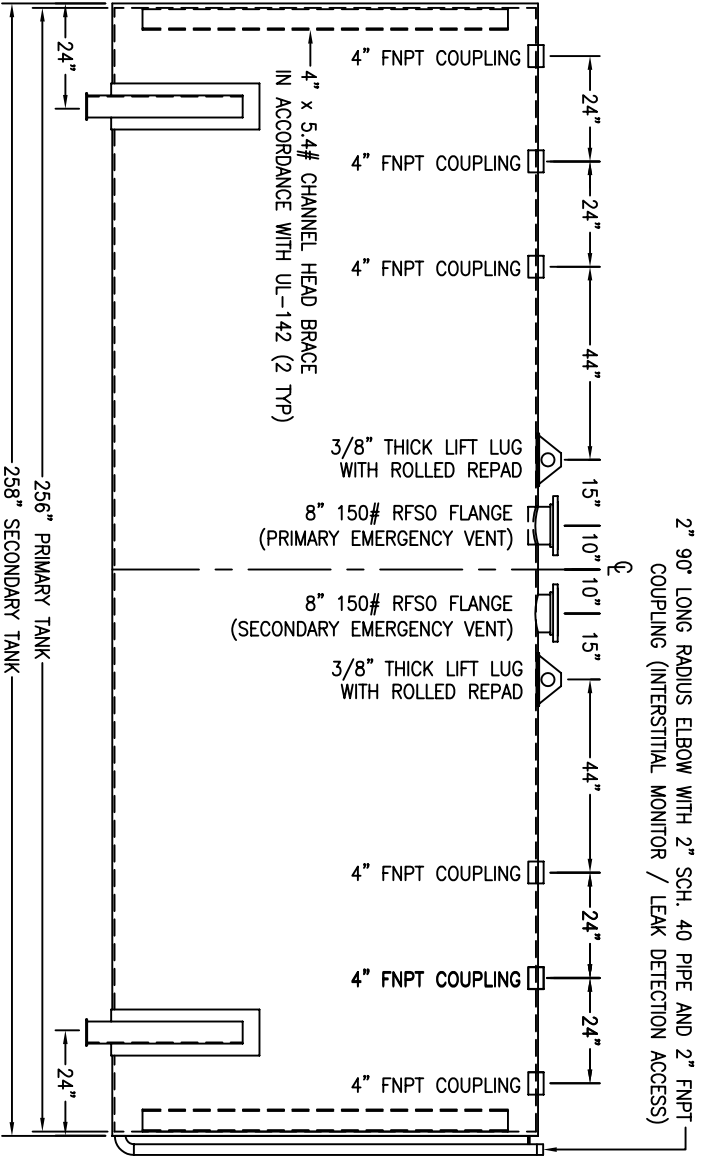

CUSTOMER APPROVAL SIGNATURE/DATE:

8,000 GALLON HORIZONTAL FLAMESHIELD D/W ABOVE GROUND TANK

QUANTITY: ONE (1) REQUIRED
WEIGHT: 0 lbs ± 5%

SURFACE PREPARATION/COATING INFORMATION:		MATERIAL /CONSTRUCTION/ LABELING INFORMATION:	
INTERIOR SURFACES: N/A		MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)	
EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST CLEAN		MATERIAL THICKNESS: PRIMARY TANK SHELL AND HEADS: 1/4"	
ONE COAT WHITE URETHANE @ 6mils DFT		SECONDARY TANK SHELL AND HEADS: 7 GA	
		CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-142 / SJI F-921	
		STANDARDS FOR STEEL ABOVEGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS	
		LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 /	
		GENERAL INDUSTRIES NAMEPLATE	

CUSTOMER: _____
PROJECT: _____
AGENT: _____

GENERAL INDUSTRIES
BUILT FOR TANKS TO PROTECT
OUR TANKS TO PROTECT
P.O. BOX 1279
MORFITT, NC 27533
PHONE: (919) 751-1791 FAX: (919) 751-8188