


*SADDLES ARE SEAL WELDED TO TANK

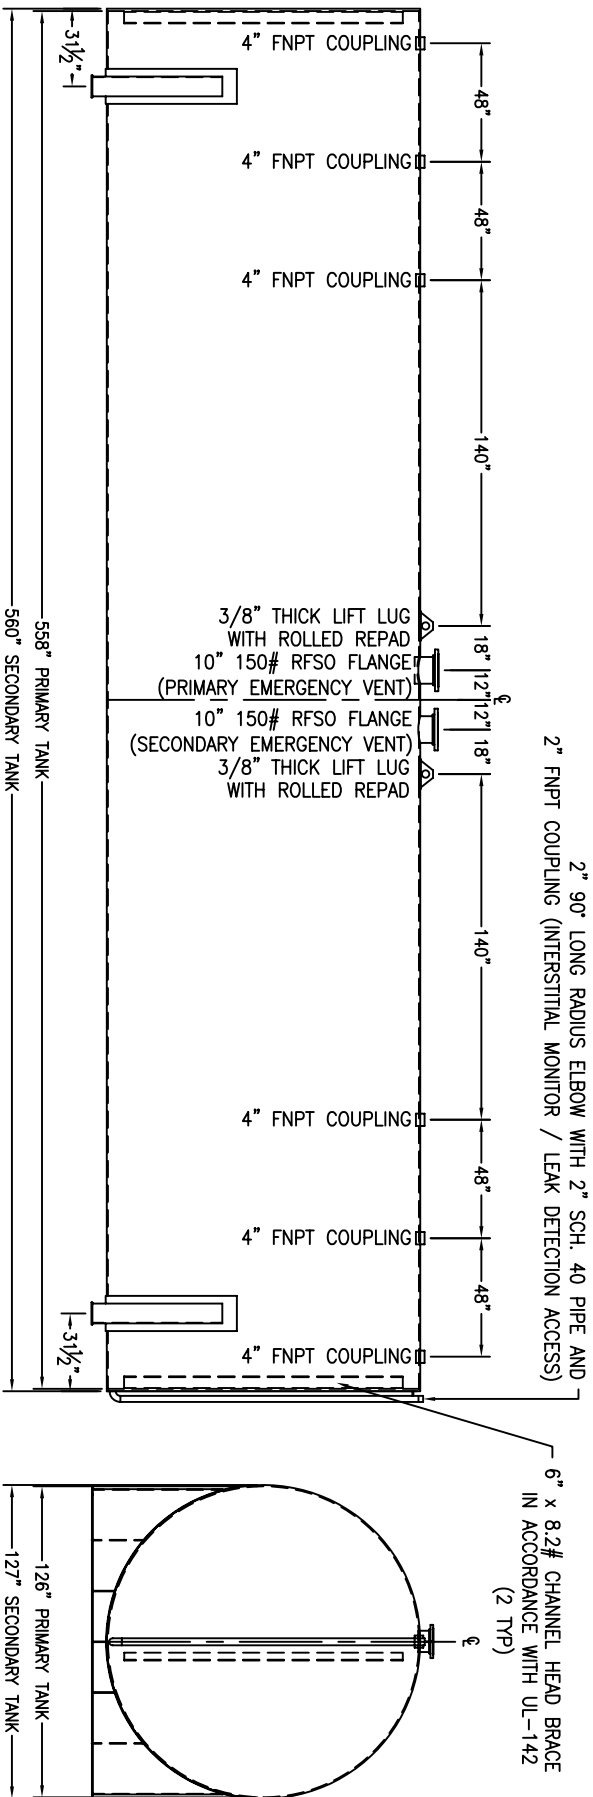

CUSTOMER APPROVAL SIGNATURE/DATE:

30,000 GALLON HORIZONTAL FLARESHEILD DW ABOVE GROUND TANK

QUANTITY: ONE (1) REQUIRED
WEIGHT: 0 lbs ± 5%

SURFACE PREPARATION/COATING INFORMATION:
INTERIOR SURFACES: N/A
EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST CLEAN
ONE COAT EPOXY PRIMER @ 4mils DFT
ONE COAT WHITE URETHANE @ 6mils DFT

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:
MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)
MATERIAL THICKNESS: PRIMARY TANK SHELL AND HEADS: 1/4"
SECONDARY TANK SHELL AND HEADS: 7 GA
CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-142 / SFI F-921
STANDARDS FOR STEEL ABOVEGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 / GENERAL INDUSTRIES NAMEPLATE

CUSTOMER: _____
PROJECT: _____
AGENT: _____

GENERAL INDUSTRIES
BUILT FOR TANKS
ODORLESS TANKS
PROJECT

P.O. BOX 1279
MILLSBORO, DE 19966
PHONE NUMBER: (302) 439-1791 FAX: (302) 439-8188

