


*SADDLES ARE SEAL WELDED TO TANK

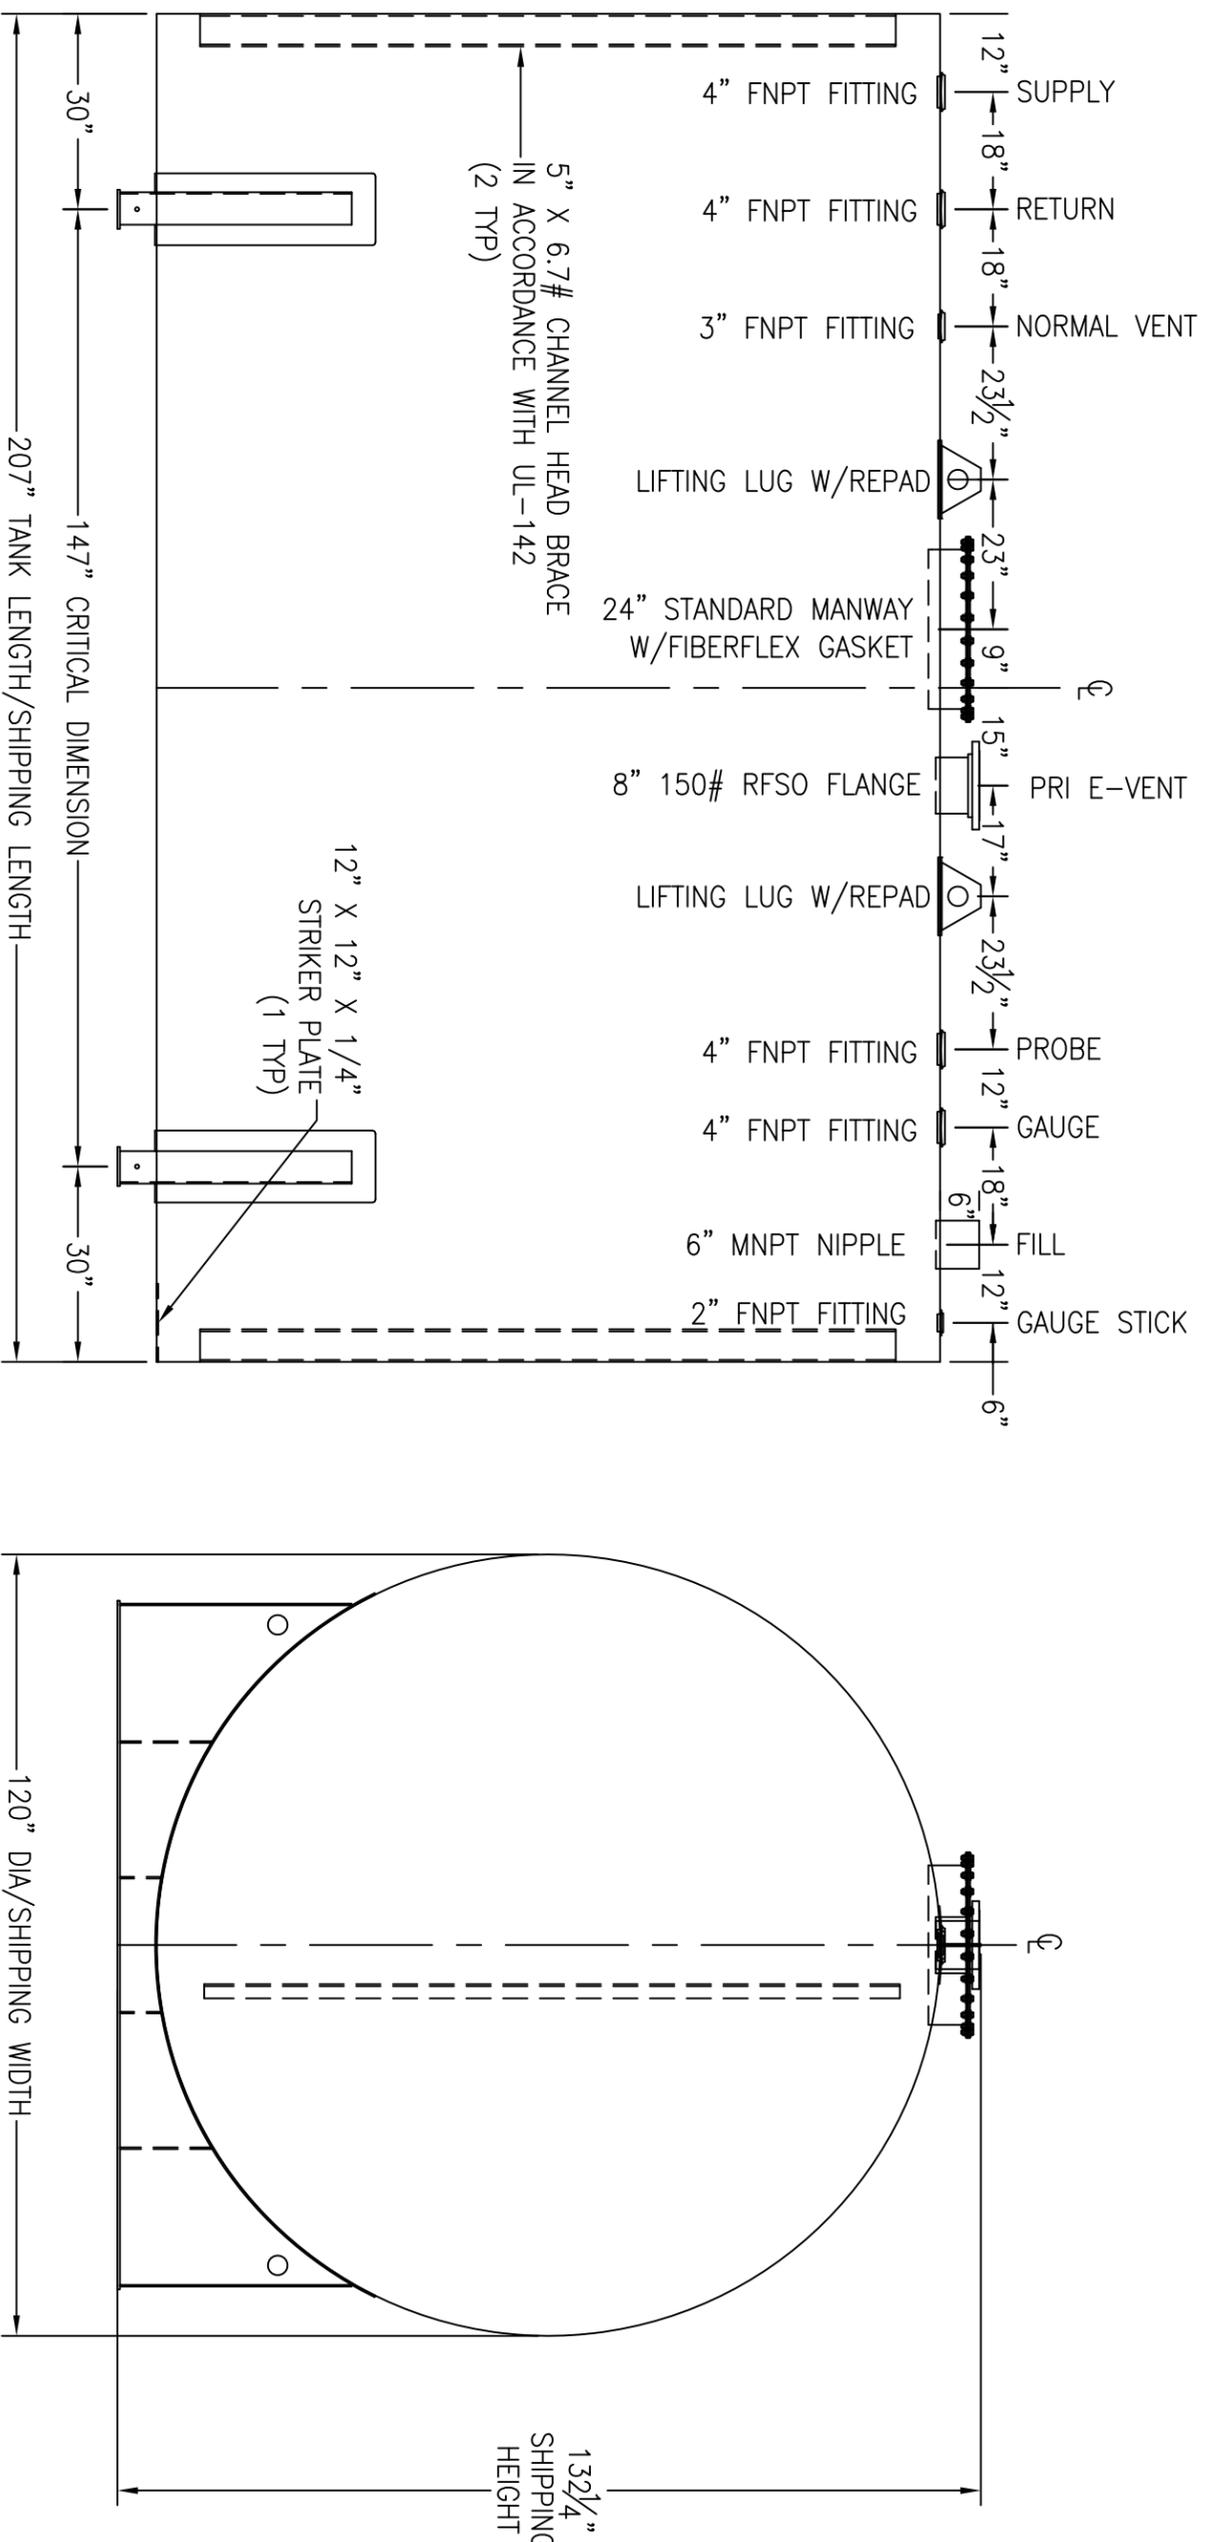

CUSTOMER APPROVAL SIGNATURE/DATE:

10,000 GALLON HORIZONTAL SW ABOVE GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES: SSPC-SP-3 POWER TOOL CLEAN WELDS ONLY
 REMOVE ALL LOOSE DEBRIS
 EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST
 5-7 MILS ALIPHATIC URETHANE (WHITE)

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL ASTM A 36 OR A 569
 MATERIAL THICKNESS: PRIMARY TANK SHELL AND HEADS: 1/4"

CUSTOMER:
 PROJECT:
 AGENT:



QUANTITY: ONE (1) REQUIRED
 WEIGHT: 9,000 lbs ± 10%

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142

P.O. BOX 1279
 PHONE: (919)751-1791
 DRAWING NUMBER: GIH10K120
 GOLDSBORO, NC 27533
 FAX: (919)751-8186

REVISED 6/15

