
1) 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE.


2) ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE.

3) THIS TANK DESIGNED FOR MAXIMUM BURIAL DEPTH OF 5 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL.



LIFT LUGS OFFSET 30" FROM CENTERLINE

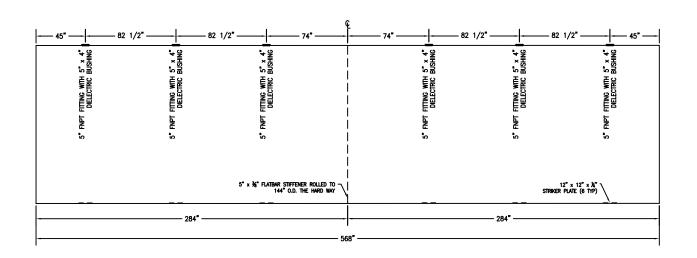



CUSTOMER APPROVAL SIGNATURE/DATI	40.000 GALLON ACT-100U S/W UNDER GROUND TANK		CUSTOMER:
	SURFACE PREPARATION/COATING INFORMATION:	MATERIAL /CONSTRUCTION/ LABELING INFORMATION:	PROJECT:
	INTERIOR SURFACES: N/A EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST CLEAN	MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569) MATERIAL THICKNESS: PRIMARY TANK: 5/16" (ROARK MINIMUM .3029 W/STIFFENER) PRIMARY HEADS: 5/16" CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR ISTEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK	AGENT: NERAL NOUSTRIES
		INSTITUTE ACTION—U SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF FRP COMPOSITE STEEL UNDERGROUND STORAGE TANKS	BUILDING THE TECT OUT THE TECT P.O. BOX 1279 GOLDSBORO, NC 27533
QUANTITY: ONE (1) REQUIRED WEIGHT: 30.250 lbs ± 5%		LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58/ STEEL TANK INSTITUTE ACT100-U / G.I. NAMEPLATE	PHONE: (919)751-1791 FAX: (919)751-8186 DRAWING NUMBER: